

GEOTHERMAL ENERGY

LUND (Sweden)

Geothermal energy takes a rather subordinate position among renewable energy sources. There are two possible sources for it: the radioactive decay of natural radio nuclides which causes the spread of heat onto the earth's surface, and the storage of solar energy in the top layers of the earth. For this reason, geothermal energy is available in many places and independent of the different seasons of the year, even if some regions do have a higher potential than others. In the city of Lund in Southern Sweden the potential is present and is exploited by the Municipality-owned utility.

THE CITY

Lund is a city with 100,000 inhabitants. It is situated in the Southwest of Sweden in the region of Skåne. Its history goes back more than 1,000 years and the city has an impressive cathedral built in the 12th century. The major neighbouring city, Malmö, is quite close and due to the new bridge crossing Øresund, the Danish capital Copenhagen is only 20 kilometres away. This makes the city quite attractive for future businesses. The ancient city centre and the presence of a big university makes the city quite charming.

Climatic data:

Degree days (Basis 17 °C): 3154
Annual mean temperature: 7.5 °C



CONTEXT


Already in 1963, the Municipality-owned utility, Lunds Energi AB, started implementing district heating (DH) in the Municipality and today the entire city centre's heat demand is covered in this way. The aim in the future is to further expand the district heating network to the housing areas around central Lund. The heat demand in these areas is currently covered either by electric heating, by oil furnaces or by natural gas furnaces. Due to the presence of hot water in the soil under Lund, two geothermal power plants were commissioned in 1985 and 1986. The hot water (21 °C) is pumped from 800 metres underground. At present, the geothermal system supplies 40% of the heat demand in the district heating network. The remaining part of the heat demand is covered by a combination of oil, biomass and natural gas combustion.

Apart from the geothermal application, the utility is also active in biomass, using wood chips in a combined heat and power implementation (CHP). The erection of three wind turbines (with a total installed capacity of 950 kW) and utilisation of district cooling as well, completes the picture of Lunds Energi AB and the Municipality as green minded and forward-looking actors in the energy market. The variety of different energy technologies makes it easy for Lunds Energi AB to fit the heat and power production to the current price level of the future liberalised energy market.

EXPERIENCE OF LUND

The basis for the supply of heat in Lund is the pipes used for distributing energy. – One network is used for distributing hot water (district heating) and one for cold water (district cooling) The production facilities within Lunds Energi AB include:

- Base load capacity: geothermal heat pumps,
- Biomass co-generation plant,
- Modern gas and oil boilers,
- Electrical boilers,
- Extensively extended district heating network,
- Gas turbine co-generation,
- Hot and cold water accumulator tanks.

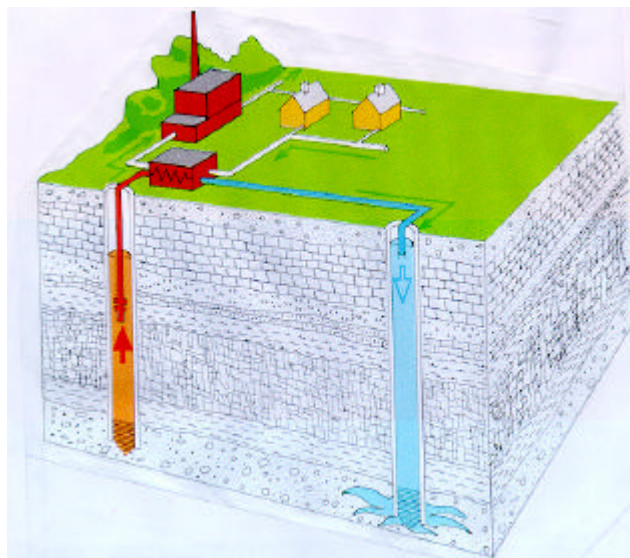

The geothermal plants

Due to the presence of the hot water in the ground below Lund, two geothermal plants with a maximum heat output of respectively 20 and 27 MW were commissioned in 1985 and 1986. The project involved close co-operation between Lunds Energi AB and the University of Lund. The principle is to pump the 21 °C hot underground water from a 800 metre deep well. Heat is transferred from the underground water to the refrigerant in the heat pump's evaporator. The underground water is re-injected into the ground at a temperature of 4 °C. The refrigerant (gaseous phase) is pressurised in the compressor. Increase in pressure implicates higher temperature of the refrigerant. Heat is transferred from the refrigerant to the district heating water in the condenser. The water for district heating, heated by the heat pump, is now at 77 °C and is used for the heat demand in the city. In ideal working conditions, the heat pump has an overall coefficient of performance (COP) of approximately 3.3, meaning that an input of one kWh electricity gives an output of 3.3 kWh heat. This is quite high and is due to the use of the hot water from the underground. Normal heat pumps installed, for example in dwellings, work with a COP of around 2.7

Maximum heat capacity	47 (20 + 27)	MW
Coefficient Of Performance	3.3	-
Flow of source water	120	L/s
Temperature of source water (in – out)	21 – 4	°C
Coolant	R134a	-
Heat produced in 1998	313	GWh
Electricity consumed in 1998	102	GWh

Technical specifications for the geothermal plants

The temperature gradient in the underground is approximately 3 °C per 100 metres. This means that with a deeper well it would be possible to achieve higher temperatures. . Already at 800 metres the water contains large amounts of salt (6 % volume) and gasses (2.5 litres of gas per 100 litres of water, the gas consists of 92 % NO_x, 3 % methane and 3 % helium). To keep these elements in the underground water, it is pressurised to 3 Bar. With a deeper well, a higher amount of gasses and salt would be present and therefore higher pressure would be necessary.

The implementation of the geothermal plants has led to a remarkable decrease in the use of fossil fuels and associated emissions. It has been calculated that in the first 5 years of running the environmental figures can be shortened to:

Amount of fossil oil fuel saved	200,000	m ³
CO ₂ -emission saved	580,000	tons
SO ₂ -emission saved	4,000	tons
NO _x -emission saved	1,400	tons

The coolant has until recently been Freon – which, if emitted into the atmosphere, contributes to depleting the ozone layer. In 1995 this was changed to the less aggressive R134a. This technique, supplying Lund with inexpensive and independently produced heat is now called "the Lund Model" and is viewed as a good example by experts both in Sweden and on an international level.

Finance

The total investment in the geothermal installations amounts to Eur 12,1 million¹ (nominal value). The investment was spread over three years with Eur 5,680,000 in 1984, Eur 5,030,000 in 1985 and Eur 1,089,000 in 1986. Later on, an additional Eur 332,000 was invested. Part of the money was cheap loans from the government – at that time investments with the objective of minimising the dependency on oil received support.

District cooling

A district cooling network has been built over the last few years. The network has its own pipes where cold water is distributed. Water at a temperature of 4 °C is delivered to consumers and when the water returns, the temperature has risen to 12-15 °C. The district cooling production plants have their own heat pumps. - The geothermal heat pumps are not used to produce district cooling due to the long distance from the heat pumps to the cooling demand. On the warmest summer days, the surplus heat from the district cooling heat pumps – fed into the district heating network - is as high as the total heat load in the entire district heating network. This means that in the summer, the geothermal heat pumps produce less heat than before the installation of district cooling. However on a yearly basis, the geothermal heat pumps produce much more heat than the district cooling heat pumps.

Biomass plant

Lunds Energi has recently invested in the neighbouring utility giving them access to a new biomass combined heat and power plant. This is situated 7 kilometres from the city of Lund, but with a new connection pipe, the citizens of Lund are now also supplied with biomass-based heat. The investment in the neighbouring utility is another step in the effort to prepare Lunds Energi AB for the liberalised energy market and to make the utility more independent of price fluctuations and other factors that Lunds Energi AB does not have the possibility of influencing.

The future liberalisation and Lunds Energi

Lunds Energi has recently invested in a huge accumulator tank for storing surplus heat production. A new accumulator for cold water for district cooling was also installed, just before Christmas 1999. This is a very good example of flexibility strategy that they are aiming at in Lund. The combination of heat pumps and electrical boilers that consume electricity, co-generation capacity – partly based on biomass - that produces electricity, and large scale possibilities for accumulating cold and warm water, makes Lunds Energi's business profitable for the company and the consumers regardless of the fluctuations in the electricity-, oil,- and gas markets. The new accumulator option gives an additional short-term flexibility, and the co-operation with the neighbouring utility, Eastern Group, as well as investments in Norwegian Hydro Power, which completes the picture of an independent energy supplier ready for the full liberalisation of the energy market.

Ongoing project

At present Lunds Energi AB prepares the drilling of an exploration well to about 3500 m. The project involved close co-operation between Lunds Energi AB and the University of Lund.

¹ One Eur equals here 9.15 Swedish Kronor

The underground water is expected to be at a temperature of 125 °C. The high temperature of the underground water makes it possible to exchange a big part of the underground water directly against the district heating network. The remaining part is used as a heat source for the existing district cooling heat pumps. Investigations show that 250 GWh/year can be direct exchanged to the district heating network and 140 GWh/year can be used as heat source for the district cooling heat pumps.

The implementation this new geothermal plant will lead to a remarkable decrease in the use of fossil fuels and associated emissions. Investigations show that the environmental figures on a yearly basis can be shortened to:

Amount of fossil fuel saved	230	GWh
CO ₂ -emission saved	54,000	tons
SO ₂ -emission saved	10	tons
NO _x -emission saved	50	tons

This new project all depends on the success on the exploration well.

EVALUATION AND OUTLOOK

Lunds Energi AB and its partners have been forward-looking in their energy planning. The use of a wide range of different energy technologies makes the utility very flexible and prepared for the free energy market. The advantages in using the local source – the underground hot water – are remarkable. Independence in foreign markets, use of local knowledge and thereby local employment, improved environment due to less use of fossil fuel and the fact that Lunds Energi is now able to sell the know-how to other countries are all factors that stress the profitable investment – for the region as a whole.

Further progress in changing from electricity based heat pumps to natural gas based heat pumps has so far been postponed due to low electricity prices and possible plans for a future CHP plant. If and when the CHP plant is implemented depends on electricity prices which at present are quite low in Sweden.

FURTHER INFORMATION

Lunds Energi AB
 Johan Holmstedt
 Trollebergsvägen 5, Box 25
 S – 22100 LUND
 Tel: +46 46 35 84 66
 Fax: +46 46 18 92 62
 E-mail: johan.holmstedt@lundsenergi.se
<http://www.lundsenergi.se>

This case study was prepared by Energie-Cités in co-operation with the utility Lunds Energi AB. It received funding from the ALTENER Programme of DG Transport and Energy of the European Commission.

